


Mains diameter Ø D	Drip leg length L	Drip leg diameter Ø DL
D ≤ 100mm	L ≥ 100mm	DL = D
125mm ≤ D ≤ 200mm	L ≥ 150mm	DL = 100 mm
D ≥ 250mm	L = D	DL = D/2



4	2	Bellows valve	VF40		
3	1	Check valve	RD40		
2	1	Double window sight glass	DW40		
1	1	Thermostatic steam trap and air vent	TH32		
Ref.	Quant.	Designation	Model	Size	Remarks / Code

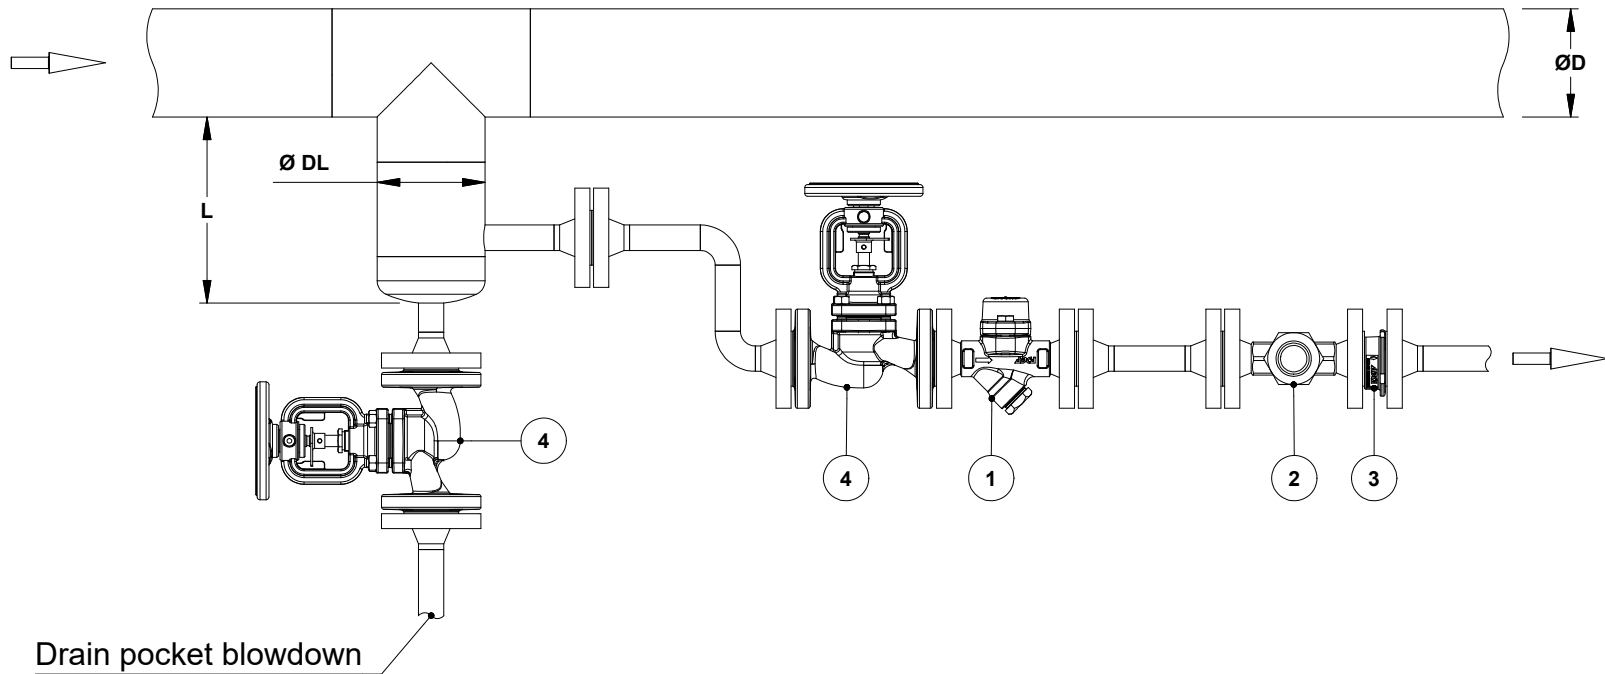

Proc. O.490

Description

DRAINAGE OF PIPES
Steam main drip leg

Des.N°.

ADFL.02.2165

Rev.: 02 Em: 22.11.17

Page: 1 de 1